
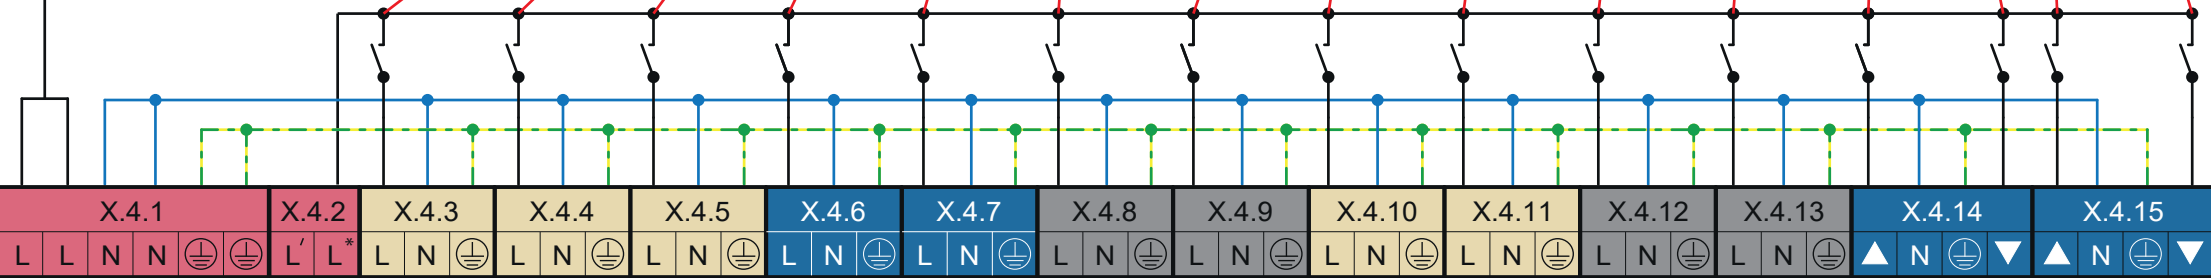



+ - L H				+ - L H				1 2	1 2	1 2	1 2	1 2	1 2	1 2	1 2	1 2	1 2 3	+ IN ⊕	+ IN ⊕	1 2	1 2	+ - L H	+ - L H																									
X.3.1				X.3.2				X.3.3	X.3.4	X.3.5	X.3.6	X.3.7	X.3.8	X.3.9	X.3.10	X.3.11	X.3.12	X.3.13	X.3.14	X.3.15	X.3.16	X.3.17	X.3.18		X.3.19																							
bus accessories																																																
bus heat pump																																																

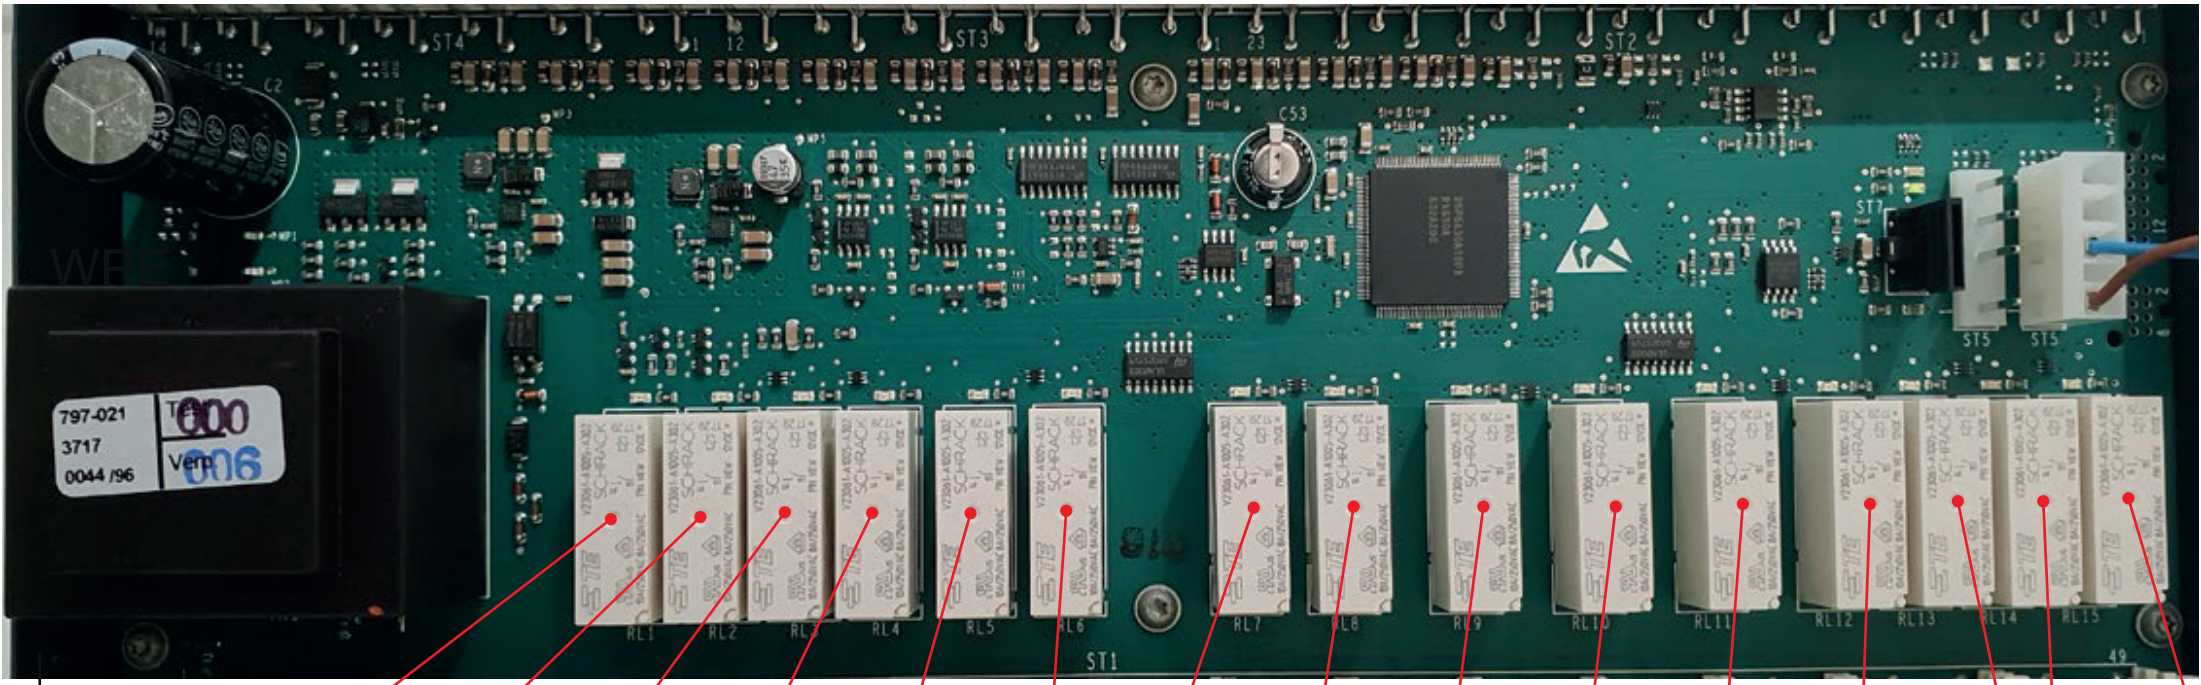

230 V for pump outputs

safety low voltage


WPMSystem terminals WPM

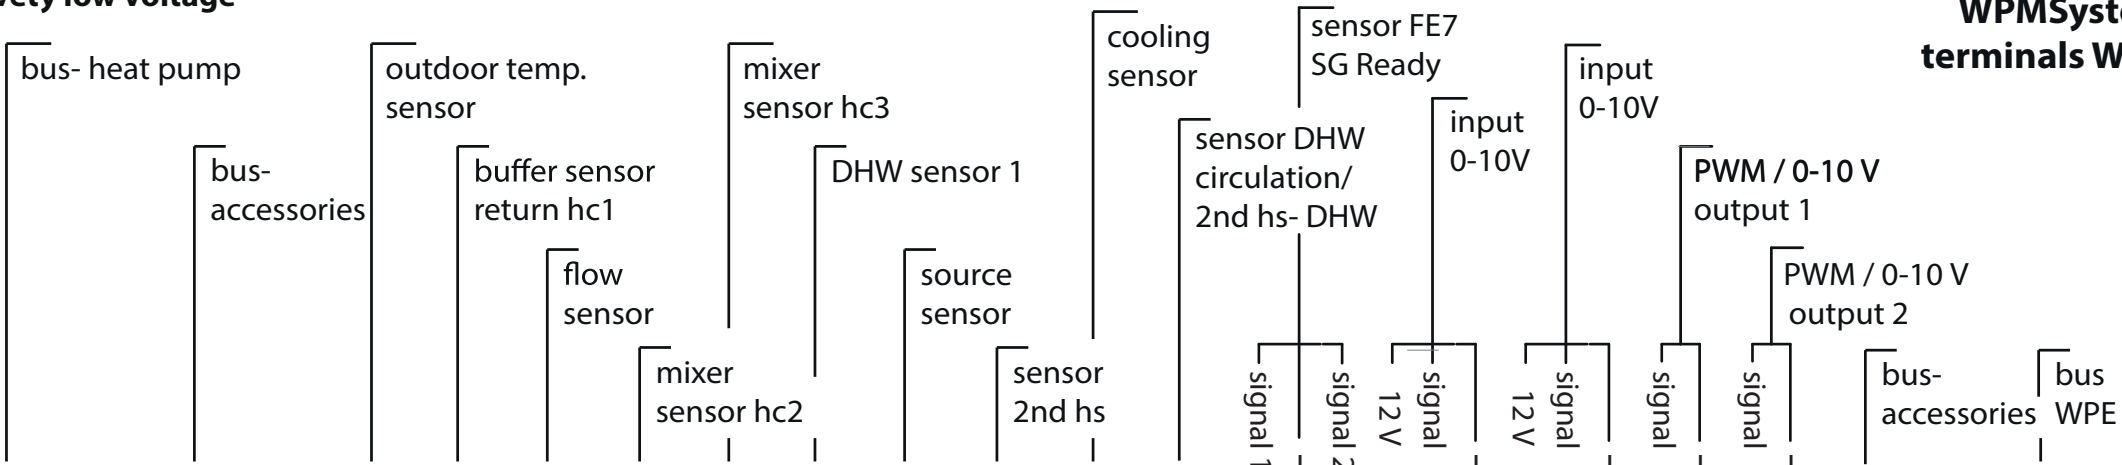

+				-				1		2		1		2		1		2		1		2		1		2		+			IN			+			IN			1		2		+				-				L				H			
X.1.1				X.1.2				X.1.3		X.1.4		X.1.5		X.1.6		X.1.7		X.1.8		X.1.9		X.1.10		X.1.11		X.1.12		X.1.13			X.1.14			X.1.15			X.1.16		X.1.17		X.1.18				X.1.19														

WPM


X.2.1						X.2.2		X.2.3			X.2.4			X.2.5			X.2.6			X.2.7			X.2.8			X.2.9			X.2.10			X.2.11			X.2.12			X.2.13			X.2.14				X.2.15			
L	L	N	N	⊕	⊕	L	L*	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	L	N	⊕	▲	N	⊕	▼	▲	N	⊕	▼

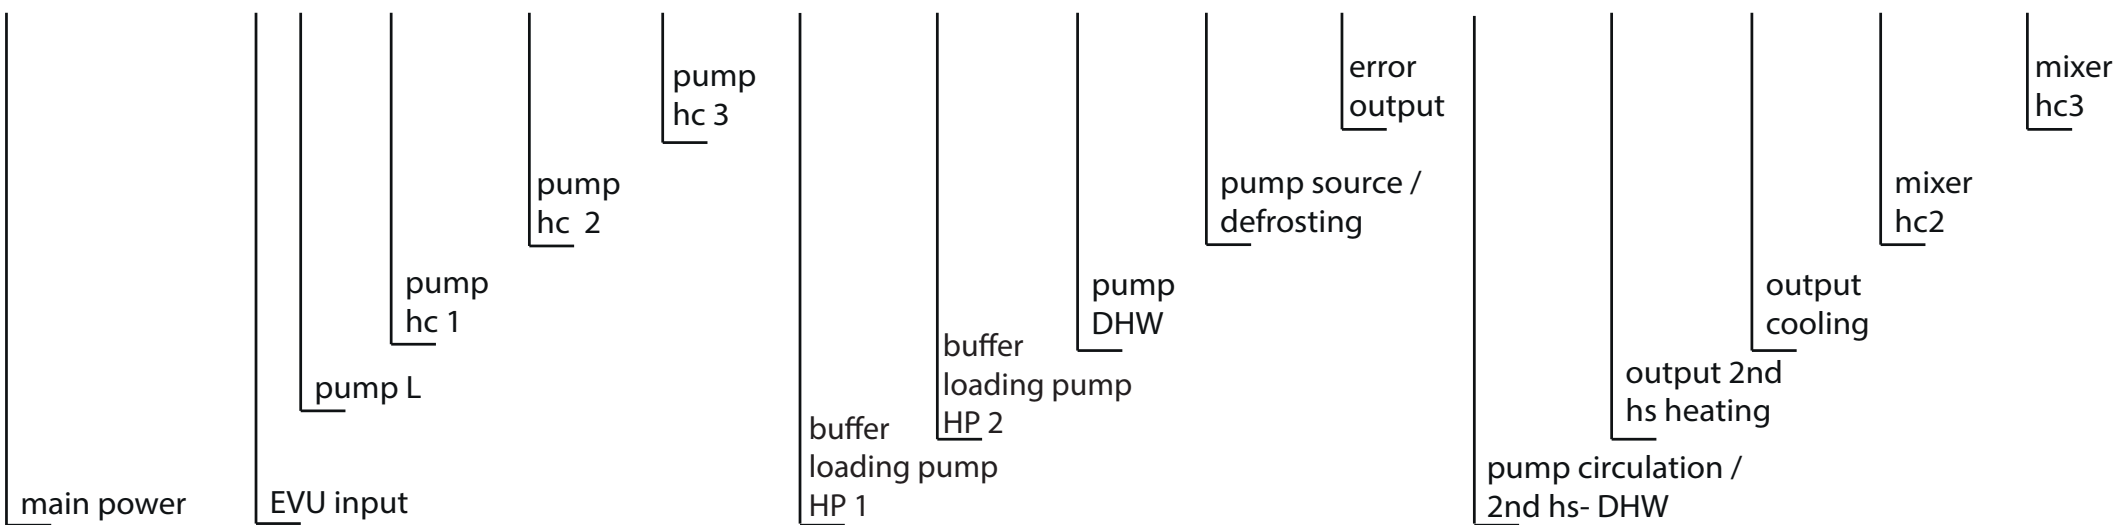

control voltage

safety low voltage


WPMSystem terminals WPE

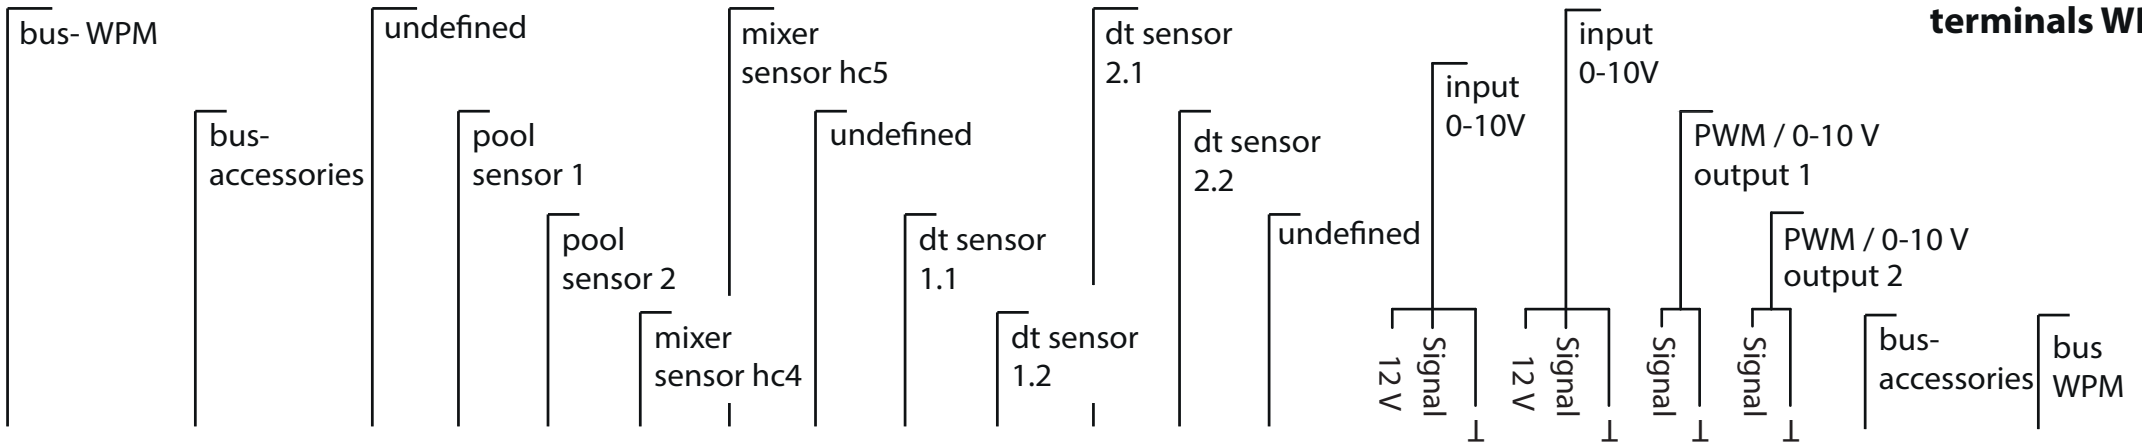

+		-		L		H		1		2		1		2		1		2		1		2		1		2		1		2		1		2		3		+		IN		⊖		+		IN		⊖		1		2		1		2		+		-		L		H		+		-		L		H	
X.3.1				X.3.2				X.3.3		X.3.4		X.3.5		X.3.6		X.3.7		X.3.8		X.3.9		X.3.10		X.3.11		X.3.12		X.3.13			X.3.14		X.3.15		X.3.16		X.3.17		X.3.18				X.3.19																														

WPE

X.4.1				X.4.2		X.4.3		X.4.4		X.4.5		X.4.6		X.4.7		X.4.8		X.4.9		X.4.10		X.4.11		X.4.12		X.4.13		X.4.14		X.4.15																															
L		L		N		N		⊖		⊖		L		L*		L		N		⊖		L		N		⊖		L		N		⊖		L		N		⊖		L		N		⊖		▲		N		⊖		▼		▲		N		⊖		▼	

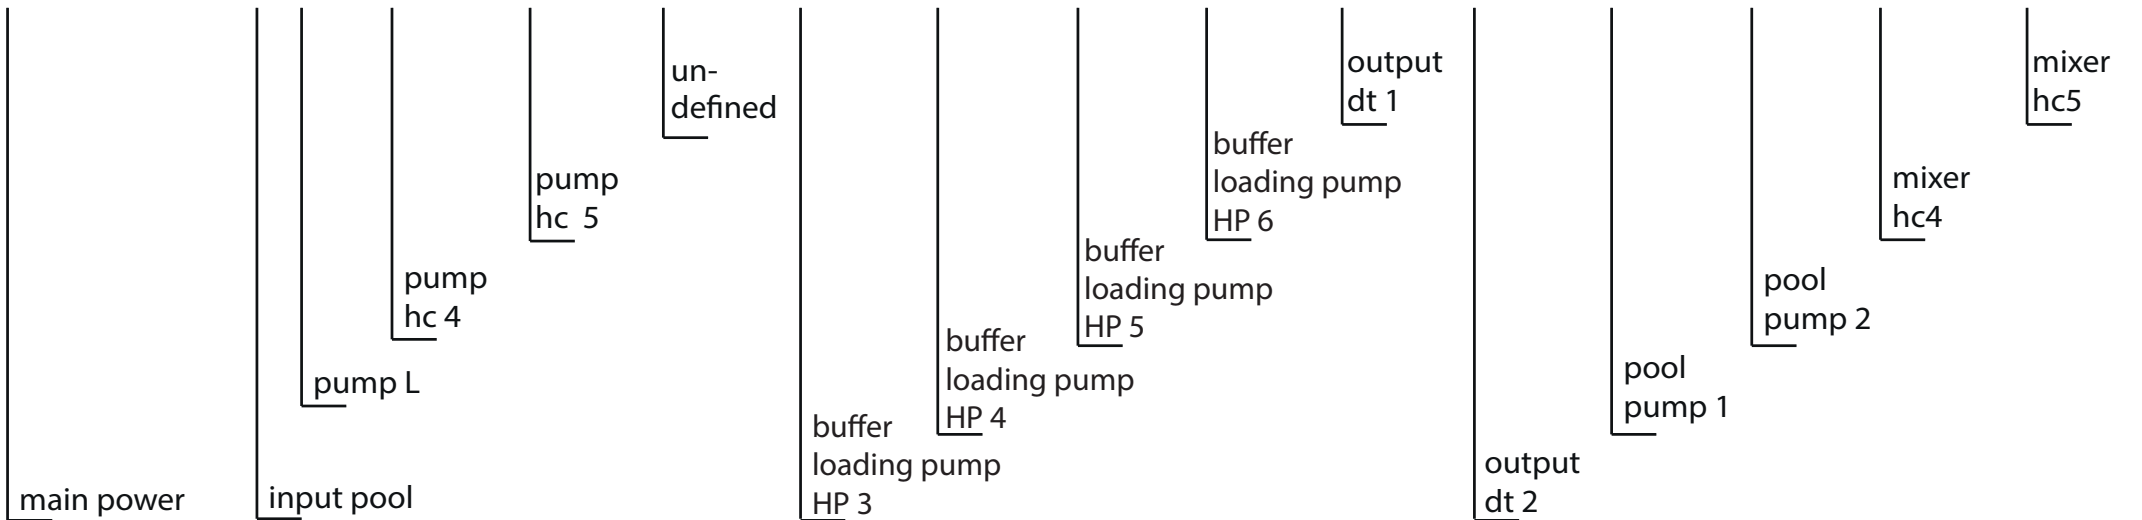

control voltage